

NO.F004 Fire extinguishing Device Installation Position Diagram

REVISIONS		
NO.	DESCRIPTION	DATE

NOTE:

PROJECT

DRAWING TITLE

CHECKED BY /DATE

DRAWN BY /DATE

DESIGNED BY /DATE


CLIENT

SCALE

STATUS


DATE

DRAWING NO.

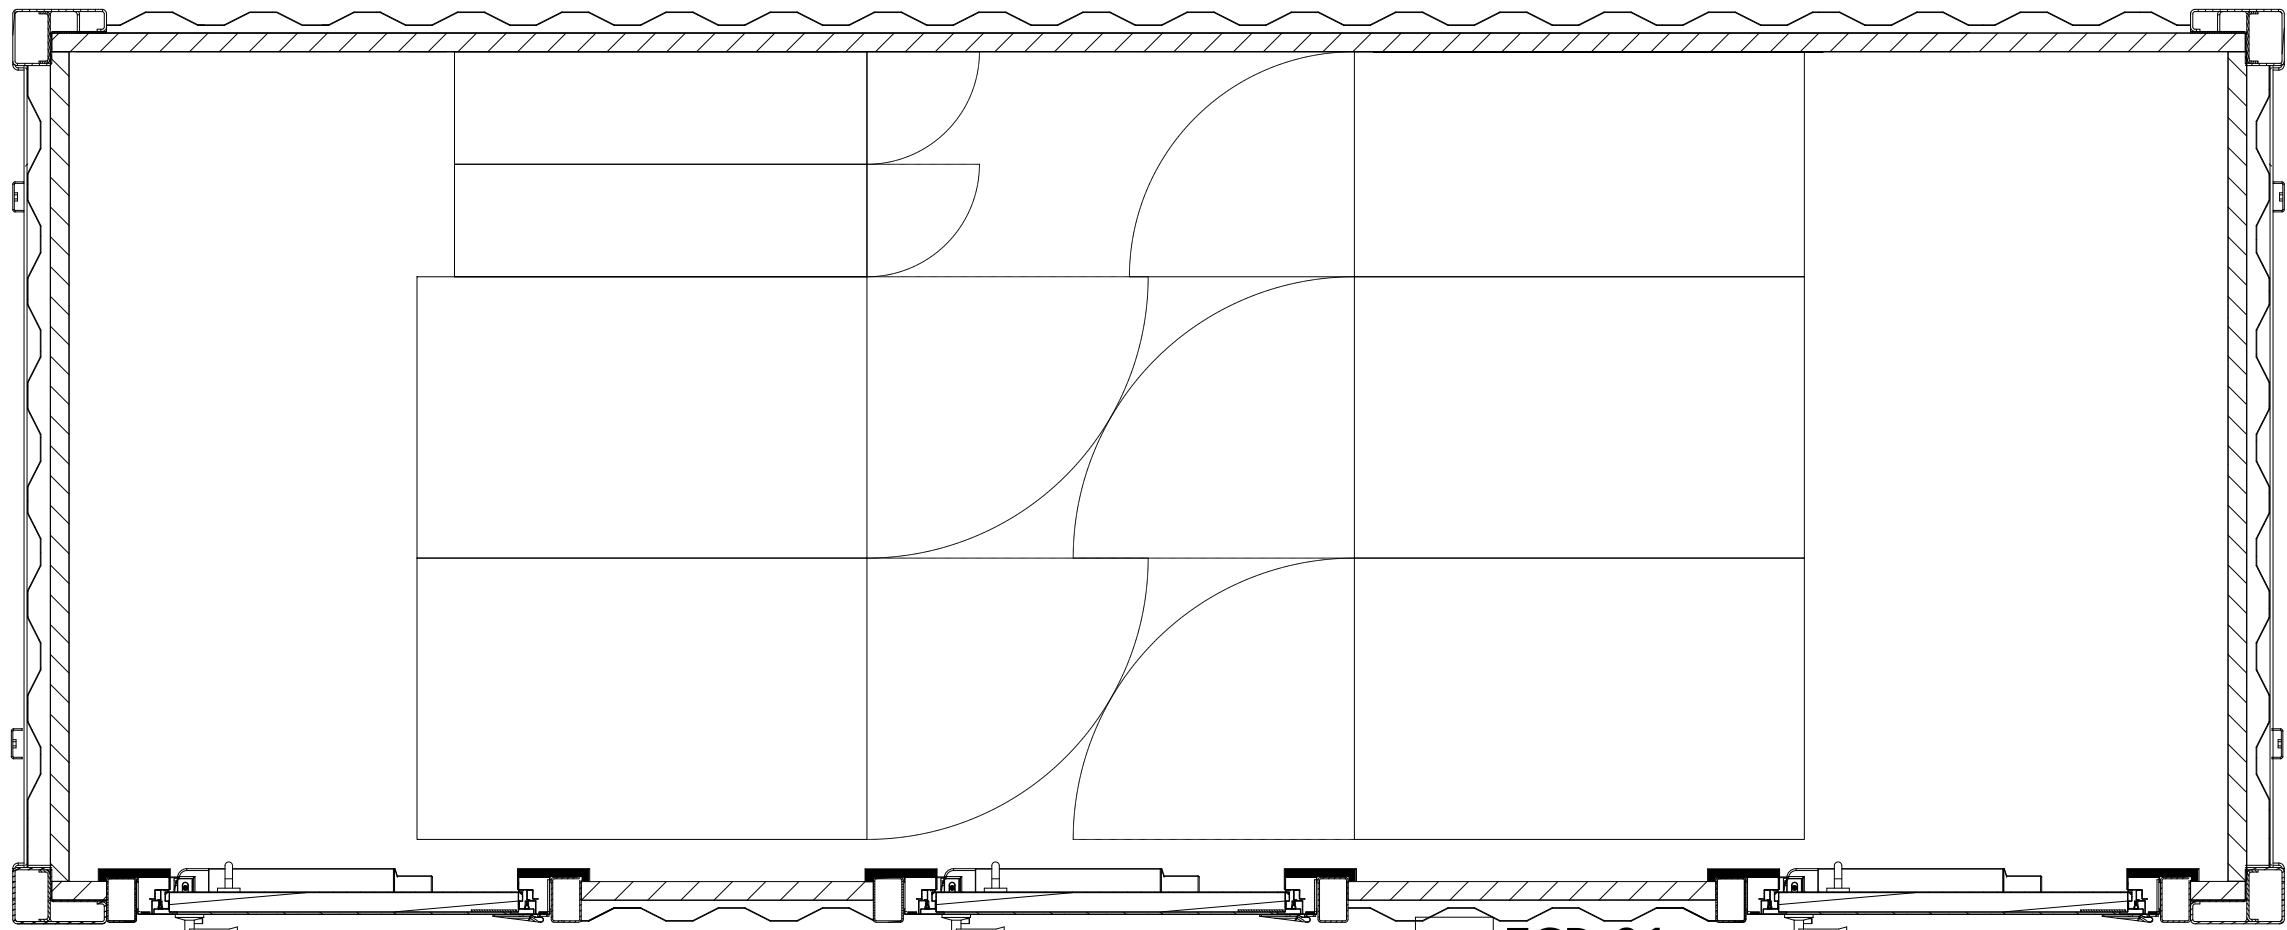

ECP ECP-01

Do not connect cables between batteries and the Extinguishing control panel during transportation. You need to connect cables onsite. Connect cables to batteries fixed in the Extinguishing control panel onsite, as shown in the figure.

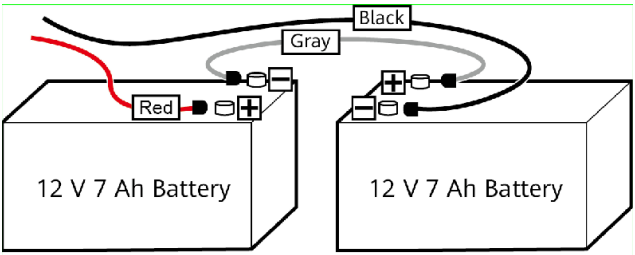

DP160C0054